

MATERIAL SPECIFICATIONS CELL

TECHNICAL SPECIFICATION

LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS: 15959/2011.

INDEX

1.00	SCOPE	3
2.00	APPLICABLE STANDARDS	3
3.00	SERVICE CONDITIONS	3
4.00	GENERAL TECHNICAL PARTICULARS	4
5.00	CONSTRUCTION	5
6.00	TOD TIMING.....	10
7.00	MAXIMUM DEMAND (KWMD)INTEGRETIION PERIOD	10
8.00	MD RESET	10
9.00	ANTI TAMPER FEATURES	10
10.00	DISPLAY OF MEASURED VALUES	12
11.00	DEMONSTRATION	14
12.00	BILLING HISTORY & LOAD SURVEY	14
13.00	COMPUTER SOFTWARE.	16
14.00	COMMON METER READING INSTRUMENT (CMRI)	19
15.00	CONNECTION DIAGRAM AND TERMINAL MARKINGS.....	22
16.00	NAME PLATE AND MARKING	22
17.00	TESTS.....	22
18.00	GUARANTEED TECHNICAL PARTICULARS.....	25
19.00	PRE DESPATCH INSPECTIONS	25
20.00	INSPECTION AFTER RECEIPT AT STORES (RANDOM SAMPLE TESTING)	26
21.00	GUARANTEE.	26
22.00	PACKING.....	26
23.00	TENDER SAMPLE	27
24.00	QUALITY CONTROL.....	27
25.00	MINIMUM TESTING FACILITIES	28
26.00	MANUFACTURING ACTIVITIES	28
27.00	QUALITY ASSURANCE PLAN	31
28.00	COMPONENT SPECIFICATION	31
29.00	SCHEDULES.....	31
	SCHEDULE 'C'	ERROR! BOOKMARK NOT DEFINED.
	TENDERER'S EXPERIENCE	ERROR! BOOKMARK NOT DEFINED.
	ANNEXURE I	32
	ANNEXURE II	34
	SCHEDULE 'A'	38

TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET ENERGY METER AS PER IS 15959/2011

1.00 SCOPE

This specification covers the Design, Manufacture, Testing and Supply of ISI marked LT AC Single Phase 5-30 Amps Static Net Energy Meters suitable for measurement of Energy (kWh) and Demand (kWMD) in Single Phase, Two wire system of LT Consumers which covers the facility of recording the import & export energy. The meter shall be suitable for measurement of energy of both import and export of electricity so as to calculate Net Active Energy.

2.00 APPLICABLE STANDARDS

IS: 15959 / 2011 Data Exchange for Electricity Meter Reading, Tariff and Load Control – companion specification for **Category C3 Meters**.

IS: 13779 / 1999 (amended up to date) and other relevant IS specifications including CBIP Tech. report 88 amended up to date, CEA regulations & MERC guidelines with latest amendments.

IS: 15707 / 2006: Specification for Testing, evaluation, installation & maintenance of AC Electricity Meters-Code of Practice.

The specification given in this document supersedes the relevant clauses of IS: 13779 / 1999 (amended up to date) wherever applicable.

The equipment meeting with the requirements of other authoritative standards, which ensures equal or better quality than the standard mentioned above, also shall be considered. For conflict related with other parts of the specification, the order of priority shall be – (i) this technical specification, (ii) IS: 13779 / 1999 (amended up to date).

3.00 SERVICE CONDITIONS

The meters to be supplied against this specification shall be suitable for satisfactory continuous operation under the following tropical conditions:

Environmental Conditions

a) Maximum ambient temperature	55 ⁰ C
b) Maximum ambient temperature in shade	45 ⁰ C
c) Minimum temperature of air in shade	35 ⁰ C
d) Maximum daily average temperature	40 ⁰ C
e) Maximum yearly weighted average temperature	32 ⁰ C
f) Relative Humidity	10 to 100 %
g) Maximum Annual rainfall	1,450 mm
h) Maximum wind pressure	150 Kg/m ²
i) Maximum altitude above mean sea level	1,000 meters

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

- | | |
|--|--------------|
| j) Isoceraunic level | 50 days/year |
| k) Seismic level (Horizontal acceleration) | 0.3 g |
| l) Climate: Moderately hot and humid tropical climate conducive to rust and fungus growth. | |

4.00 GENERAL TECHNICAL PARTICULARS

4.01 The meter shall bear ISI mark.

4.02 Class of Accuracy:

The class of accuracy of the Energy Meter shall be 1.0. The accuracy shall not drift with time.

4.03 Current & Voltage Rating:

- 1) The current rating shall be 5 - 30 Amps.
- 2) Rated basic current (I_b) for LT Energy Meters shall be 5 Amps.
- 3) The maximum continuous current (I_{max}) shall be 600% of rated basic current, i.e. 30 Amps. Moreover the 5 - 30 Amps meters shall work accurately upto 150% of I_{max} , i.e. 45 Amps.
- 4) The Voltage Rating shall be 240 volts. The voltage range shall be (-) 40% to (+) 20% of rated voltage, i.e. 144 Volts to 288 Volts.

4.04 Temperature:

The standard reference temperature for performance shall be 27° C. The mean temperature co-efficient shall not exceed 0.07%. Temperature rise shall be as per IS: 13779 / 1999 (amended up to date).

4.05 Power Factor:

The meter shall work for Zero to unity PF (All lag or lead).

4.06 Power Consumption:

1) Voltage Circuit:

The active & apparent power consumption in each voltage circuit including power supply of meter at reference voltage, reference temperature & frequency shall not exceed 2.0 Watt & 10 VA.

2) Current Circuit:

The apparent power taken by current circuit at basic current, reference frequency & reference temperature shall not exceed 4.0 VA as per IS: 13779 / 1999 (amended upto date).

4.07 Starting Current:

The meter shall start registering the energy at 0.2 % of basic current (I_b).

4.08 Frequency:

The rated frequency shall be 50 Hz with a tolerance of $\pm 5\%$.

5.00 CONSTRUCTION

- 5.01 The meter shall be projection type and dust and moisture proof. The meter base & cover shall be made out of unbreakable, high grade, fire resistant Polycarbonate material so as to give it tough and non-breakable qualities. The meter body shall be type tested for IP 51 degree of protection as per IS: 12063 against ingress of dust, moisture & vermin.
- 5.02 Moulded terminal block for current and voltage connections conforming to IS: 13779 / 1999 (amended up to date) to meet the requirement of terminal connection arrangement shall be provided. The termination arrangement shall be provided with an extended transparent / translucent / opaque. Terminal cover as per clause number 6.5.2 of IS: 13779 and shall be sealable independently to prevent unauthorized tampering. Proper size of grooves shall be provided at bottom of this terminal cover for incoming and outgoing service wires.
- 5.03 The terminal block, the terminal cover and the meter case shall ensure reasonable safety against the spread of fire. They shall not be ignited by thermal overload of live parts in contact with them.
- 5.04 All insulating materials used in the construction of the meter shall be substantially non-hygroscopic, non ageing and of tested quality.
- 5.05 All parts that are likely to develop corrosion under normal working condition shall be effectively protected against corrosion by suitable method to achieve durable results.
- 5.06 Sealing provision shall be made against opening of the terminal cover and front cover. It is necessary to provide screws with two holes for sealing purpose. The meter shall be pilfer-proof & tamper-proof. The provision shall be made on the Meter for at least two seals to be put by utility user.
- 5.07 The transparent / translucent base and transparent cover shall be ultrasonically welded / laser welded (continuous welding) so that once the meter is manufactured and tested at factory, it shall not be possible to open the cover at site except the terminal cover. The Manufacturer shall put at least one seal on meter body before dispatch. The thickness of material for meter body shall be 2 mm minimum.
- 5.08 The meter shall be completely factory sealed except the terminal block cover.
- 5.09 A sticker label containing warning notice in Marathi language which is to be stick up on meters front cover or printed on meter name plate with easily readable font size not less than 10 in red colour, which reads as

“सावधान! मीटरला फेरफार करण्याचा प्रयत्न केल्यास अधिकतम वेगाने वीज नोंदणी होणार.”

5.10 REAL TIME INTERNAL CLOCK (RTC)

The real time quartz clock shall be used in the meter for maintaining time (IST) and calendar. The RTC shall be non - rechargeable and shall be pre-programmed for 30 Years Day / date without any necessity for correction. The time accuracy shall be as per provisions of CBIP Tech Report 88. Facility for adjustment of real time shall be provided through CMRI with proper security.

The clock day / date setting and synchronization shall only be possible through password / Key code command from CMRI or Meter testing work bench and this shall need password enabling for meter.

The RTC shall have long life (10 Years) Non rechargeable battery. The RTC battery & the battery for display in case of power failure shall be separate.

5.11 A push button shall be provided for scrolling the parameters in Alternate Display (On Demand) mode.

5.12 The provision shall be made on the Meter for at least two seals to be put by utility user.

5.13 The energy meter shall clearly indicate the Export and Import connection marking on the terminal block or terminal cover as like the "→/I" indicates that Import terminal / forward and "←/E" indicates that Export terminal / reverse energy measurement.

5.14 OUTPUT DEVICE.

The meter shall be provided with flashing LED to represent the pulse output for testing the meter accuracy by suitable testing equipment. The operation indicators must be visible from front. The test output devices shall be provided in the form of blinking LED. The pulse rates of output devices which is Pulse / kWh (meter constant) shall be indelibly provided on the nameplate. It shall be possible to check the accuracy of active energy measurement of the meter on site by means of LED output. Resolution of the test shall be sufficient to enable the starting current test in less than 10 minutes and accuracy test at the lowest load shall be completed with desired accuracy within 5 minutes.

5.15 There shall be one CT in Neutral circuit and one shunt / CT in phase circuit. The current whichever is measured as higher either by CT or shunt shall be used for processing / computing energy. The shunt shall be manganin based and e-beam welded for the construction purpose.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

- 5.16 The meter shall have CTs with magnetic shielding and same shall be tested separately prior to assembly.
- 5.17 PCB used in meter shall be made by Surface Mounting Technology.
- 5.18 The meter shall be capable to withstand phase to phase voltage (440 V) if applied between phase to neutral for minimum 5 min.
- 5.19 Power supply unit in the meter shall not be affected by magnetic influence.
- 5.20 Non specified display parameters in the meter shall be blocked. Display parameters in the meter shall not be accessible for reprogramming at site through any kind of communication.
- 5.21 Complete metering system & measurement shall not be affected by the external electromagnetic interference such as electrical discharge of cables and capacitors, harmonics, electrostatic discharges, external magnetic fields and DC current in AC supply etc. The Meter shall meet the requirement of CBIP Tech. report 325 (amended up to date).
- 5.22 The meter shall remain immune for the test of electromagnetic HF/RF field defined under the test no. 4.0 for EMI/EMC of IS 13779:1999 amended up to date.
- 5.23 For any higher signals than the present standards for Electromagnetic HF/RF field and MSEDCL technical specifications indicated above, the energy meters shall be immune & the accuracy of meter shall not get affected.
- 5.24 The communication of energy meters shall not be affected considering the above feature stated in the clause 5.22 & 5.23.
- 5.25 The accuracy of the meter and the measurement by meter shall not get influenced by injection of high frequency AC Voltage / chopped signal / DC signal and harmonics on the terminals of the meter.
- 5.26 The watch dog provided shall invariably protect the hanging of microprocessor during such type of tampering devices.
- 5.27 The meter accuracy shall not be affected by magnetic field from all sides of the meter i.e. front, sides, top and bottom of the meter.
- 5.28 The meter shall record & display total kWh energy & fundamental energy separately
- 5.29 Self Diagnostic Features.
- (a) The meter shall display unsatisfactory functioning or nonfunctioning of Real Time Clock battery.
- (b) All display segments: "LCD Test" display shall be provided for this purpose.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

5.30 Wireless / Cable less design:

The meter PCB shall be wireless to avoid improper soldering & loose connection / contact.

5.31 **COMMUNICATION CAPABILITY**

The meter shall be provided with two ports for communication of the measured / collected data.

1. The meter shall be provided with two ports for communication of the measured / collected data as per the IS: 15959 / 2011 amended upto date i.e. a hardware port compatible with RS 232 specifications RJ - 11 type which shall be used for remote access through suitable Modem (4G/2G/3G/NB-IoT/PLCC/LPRF)
2. Optical port complying with hardware specifications detailed in IEC – 62056 - 21. This shall be used for local data downloading through a DLMS compliant CMRI. RS 232 port on terminal block is also acceptable.


Sealing arrangement for Optical & RS 232 port as required shall be provided.

Both ports shall support the default and minimum baud rate of 9600 bps.

Necessary chord for Optical Port of minimum length of 1 mtr. in the ratio 50:1 shall be provided free of cost.

The minimum requirements for RS-232 based systems are described below:

- i. The interface shall meet all the requirements of RS-232 specifications in terms of Physical media, Network topologies, maximum devices, maximum distance, mode of operation, etc.
- ii. RJ 11 type connectors have to be provided to easily terminate the twisted pair.

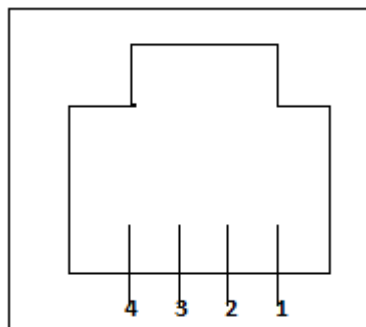

PIN DESCRIPTION

Pin No	Signal
1	RTS (Ready To Send)
2	Ground (GND)
3	Transmit Data (Tx)
4	Receive Data (Rx)

5.32 The meter shall be supplied with battery back up feature for displaying the parameters during power OFF condition. Battery life shall be minimum ten years.

Separate push button shall be provided for activation of battery during power OFF condition. Alternatively, push button provided for displaying alternate mode (On Demand Mode) parameters shall also be acceptable for activation of battery during power OFF condition.

After activating the battery during power OFF condition, the meter shall display all Default Display (Auto Scrolling Mode) parameters only once, after which the battery shall switch OFF automatically. The battery shall be locked after 3 operations during one power OFF cycle.

5.33 The accuracy of the meter shall not be affected with the application of abnormal voltage / frequency generating device such as spark discharge of approximately 35 KV. The meter shall be tested by feeding the output of this device to meter in any of the following manner for 10 minutes:

- a) On any of the phases or neutral terminals.
- b) On any connecting wires of the meter (Voltage discharge with 0-10 mm spark gap).
- c) At any place in load circuit.
- d) Anywhere on meter body.

The accuracy of meter shall be checked before and after the application of above device.

5.34 The data stored in the meters shall not be lost in the event of power failure. The meter shall have Non Volatile Memory (NVM), which does not need any battery backup.

5.35 Reverse reading lock of main KWh reading is to be incorporated with necessary software modification if required additionally.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

6.00 TOD TIMING.

There shall be provision for at least 6 (Six) TOD time zones for energy and demand. The number and timings of these TOD time Zones shall be programmable. At present the time zones shall be programmed as below.

Zone A (TZ1): 00=00 Hrs. to 06=00 Hrs. and 22=00 Hrs. to 24=00 Hrs

Zone B (TZ2): 06=00 Hrs. to 09=00 Hrs. and 12=00 Hrs. to 18=00 Hrs

Zone C (TZ3): 09=00 Hrs. to 12=00 Hrs.

Zone D (TZ4): 18=00 Hrs. to 22=00 Hrs.

7.00 MAXIMUM DEMAND (KWMD)INTEGRETIION PERIOD

The maximum demand (KWMD) integration period shall be set at 30 minutes with block window method.

8.00 MD RESET

It shall be possible to reset MD by the following options:

- a) Communication driven reset through hand held terminal (CMRI).
- b) Auto reset at 24:00 hrs at the end of each billing cycle: Automatic reset at the end of certain predefined period (say, end of the month (00.00 Hrs)). This option shall be blocked by default and made programmable through hand held terminal (CMRI) for the actual date required. No push button shall be provided for MD reset.

9.00 ANTI TAMPER FEATURES

The meter shall detect and register the energy correctly under any one or combination of following tamper conditions:

- 9.01 Load through local Earth.
- 9.02 The meter shall work accurately without earth.
- 9.03 Where neutral is disconnected from the load or from the supply side or both the load and supply side, the meter shall record the energy proportionate to the current drawn through the meter (min 20 % Ib for 5-30 A) at reference voltage and unity Power Factor. $\pm 5\%$ error in recording is admissible.
 - a) In case of the neutral missing from load or supply side, the energy may be registered as per the current direction in respective import/export registers.
 - b) In case of the neutral missing from both sides, the energy should be registered in import mode.

All the above tampers shall be verified at basic current at reference voltage.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

The potential link shall not be provided on terminal block outside the main meter cover.

Visual indication shall be provided to show tamper conditions stated above.

- 9.04 The meter shall be immune to the magnetic field (AC / DC / Permanent) up to 0.2 Tesla (except 0.2 Tesla AC). Under influence of any magnetic field (AC / DC / Permanent) more than 0.2 Tesla, if the accuracy of the meter gets affected, then the same shall be recorded as magnetic tamper event with date & time stamping and the meter shall record energy considering maximum value current (I_{max}) at reference voltage & unity power factor.

In case of magnetic tamper during export / reverse mode, the energy meter shall record & add the same energy considering I_{max} in import / forward mode.

- 9.05 In the event the meter body cover (lid) is forcibly opened, even by 2 to 4 mm variation of the meter cover, same shall be recorded as tamper event with date & time stamping and the meter shall continuously display that the cover has been tampered. It is suggested that the manufacturer shall develop their software such that the event should be recorded exactly at the time of occurrence and the event should be displayed after fitting of meter body cover. After the meter cover is fitted, it shall get activated immediately without any delay displaying the tamper event.

- 9.06 The meter shall remain immune for the test of electromagnetic HF/RF defined under the test no. 4.0 for EMI/EMC of IS 13779:1999 amended up to date. For any higher signals than the present standards and MSEDCL technical specifications indicated above, the energy meters shall be immune & the accuracy of meter shall not get affected.

The energy meter shall be capable to record & display all tamper with date and time stamping.

The meter shall be capable to record power ON/OFF events in the meter memory.

Minimum 200 numbers of events (occurrences & restoration with date & time) shall be available in the meter memory. The recording of abnormal events shall be on FIFO basis. 10 nos. slots for each tamper Occurrence & Restoration except meter cover open shall be provided. Only one slot for Meter cover open tamper shall be provided.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

10.00 DISPLAY OF MEASURED VALUES

10.01 The display shall be permanently backlit LCD, visible from the front of the meter. The display shall be electronic and when the meter is not energized, the electronic display need not be visible.

10.02 MINIMUM CHARACTER SIZE

The energy display shall be minimum 5 digits. The height of the display characters for the principal parameters values shall not be less than 5 mm. The size of digit shall be minimum 9x5 mm.

10.03 The principal unit for the measured values shall be the kilowatt hour (kWh) and the maximum demand in kW (kWMD) alongwith the time.

10.04 The decimal units shall not be displayed for cumulative kWh in auto scroll mode. However it shall be displayed in push button mode for high resolution display for testing.

10.05 The meter shall be pre-programmed for following details.

Voltage: 240 V

Integration period for kWMD shall be of 30 minutes real time based.

The meter shall auto reset kW maximum demand (kWMD) at 2400 Hrs. of last day of each calendar month and this value shall be stored in the memory along with the cumulative kWh reading.

No reset push button shall be provided.

The display parameters shall be preprogrammed at factory as per cl. no. 10.06.

10.06 DISPLAY MEASURING PARAMETERS

There shall be two modes of display - (a) Auto Scrolling mode (Default Display) and (b) On Demand Mode (Push Button Mode (Alternate Display)

(A) DEFAULT DISPLAY (AUTO SCROLLING MODE)

All the following parameters shall be available in Default Display (Auto Scrolling Mode).

The sequence of display of various electrical parameters in auto scroll & On Demand mode shall be as per table 27 & 29 (except 8 & 9) of Annex E of IS: 15959 / 2011.

SR. NO.	PARAMETERS	OBIS CODE						Interface Class No./ Attribute
		A	B	C	D	E	F	
1.00	LCD Check							
2.00	Real time & date.	0	0	1	0	0	255	8

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

3.00	Instantaneous active load in Kilowatt.	1	0	1	7	0	255	3/2
4.00	Total Active Energy (kWh) (Export mode) Including Harmonics.	1	0	2	8	0	255	3/2
5.00	Maximum demand (kWMD) with date & time. (Export mode)	1	0	2	6	0	255	4/2, 5
6.00	Total Active Energy (kWh) (Import Mode) Including Harmonics.	1	0	1	8	0	255	3/2
7.00	Maximum demand (kWMD) with date & time (Import Mode)	1	0	1	6	0	255	4/2,5
8.00	Fundamental Energy (kWh) (Export) Excluding Harmonics.	1	65	2	8	0	255	3/2
9.00	Fundamental Energy (kWh) (Import) Excluding Harmonics.	1	65	1	8	0	255	3/2
10.00	Tamper event of Meter Cover Open with Date & Time							
11.00	Voltage % THD (Import),	1	66	1	32	0	255	
12.00	Current % THD (Import)	1	66	2	32	0	255	
13.00	Voltage % THD (Export),	1	66	1	31	0	255	
14.00	Current % THD (Export)	1	66	2	31	0	255	

Note:

- (1) Active cumulative energy shall be displayed for minimum 20 seconds. All other parameters shall be displayed for minimum 6 seconds including LCD check.
- (2) The meter shall display the tamper event of Meter Cover Open with Date & Time in auto scroll mode along with other parameters.
- (3) The Default Display (Auto scrolling mode) shall switch to Alternate Display (On Demand Display Mode) after pressing the push button continuously for 5 seconds.

The Alternate Display shall switch over to Default Display if the push button is not operated for 15 seconds.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

**(B) ON-DEMAND MODE THROUGH PUSH BUTTON (ALTERNATE
DISPLAY MODE).**

SR. NO.	PARAMETERS	OBIS CODE						Interface Class No./ Attribute
		A	B	C	D	E	F	
1.	Cumulative Active Energy (kWh) for each calendar month for previous six months with display of month. (Export mode)	1	0	2	8	0	255	3/2
2.	Maximum demand (kWMD) in a calendar month for previous six months with date & time. (Export mode)	1	0	2	6	0	255	4/2, 5
3.	Cumulative Active Energy (kWh) for each calendar month for previous six months with display of month. (Import mode)	1	0	1	8	0	255	3/2
4.	Maximum demand (kWMD) in a calendar month for previous six months with date & time. (Import mode)	1	0	1	6	0	255	4/2, 5
5.	Magnetic tamper event with date / time							

Magnetic tamper event with date / time: This shall be displayed as per the requirement of clause no. 9.04.

The meter shall have a non-volatile memory, so that the registered parameters will not be affected by the loss of power.

11.00 DEMONSTRATION

The purchaser reserves the right to ask for the demonstration of the equipment offered at the purchaser's place free of cost.

12.00 BILLING HISTORY & LOAD SURVEY

12.01 BILLING HISTORY.

The meter shall have sufficient non-volatile memory for recording history of billing parameters (Fundamental Cumulative kWh (Import & Export) at the time of reset and kWMD) for last 12 months.

Legends for kWh and MD shall be as below:

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

	I : Import →		E : Export ←	
Months	MD	Energy	MD	Energy
March(Current Month)	<u>MD</u>	<u>kWh</u>	<u>MD</u>	<u>kWh</u>
Feb	MD1	kWh1	MD1	kWh1
Jan	MD2	kWh2	MD2	kWh2
Dec	MD3	kWh3	MD3	kWh3
Nov	MD4	kWh4	MD4	kWh4
Oct	MD5	kWh5	MD5	kWh5
Sept	MD6	kWh6	MD6	kWh6
Aug	MD7	kWh7	MD7	kWh7
July	MD8	kWh8	MD8	kWh8
June	MD9	kWh9	MD9	kWh9
May	MD10	kWh10	MD10	kWh10
Apr	MD11	kWh11	MD11	kWh11
March	MD12	kWh12	MD12	kWh12

Details of the legends shall be self-explanatory with signed legend like

Export ←/E:

Import → /I:

12.02 LOAD SURVEY PARAMETERS.

SR. NO.	PARAMETERS	OBIS CODE						Interface Class No./ Attribute
		A	B	C	D	E	F	
1.	Fundamental kWh (Import)	1	65	1	29	0	255	3/2
2.	Fundamental kWh (Export)	1	65	2	29	0	255	3/2
3.	kWMD (Import)	1	0	1	6	0	255	4/2, 5
4.	kWMD (Export)	1	0	2	6	0	255	4/2, 5
5.	PF (Import)							
6.	PF (Export)							
7.	Voltage	1	0	12	7	0	255	3/2
8.	Current	1	0	94	91	14	255	3/2
9.	Harmonic Energy HkWh (Export)	1	66	2	29	126	255	3/2

The load survey parameters shall be selectable, however standard energy parameters like Fundamental kWh (Import), Fundamental kWh (Export) kWMD (Import & Export), Voltage, Current, & PF (Import & Export) shall be mandatory to be available for selection.

The logging interval for load survey shall be 30 minutes. Load survey data shall be logged for last 45 days on non time based basis, i.e. if there is no power for more than 24 hours, the day shall not be recorded. Whenever meter is taken out and brought to laboratory, the load survey

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

data shall be retained for the period of actual use of meter. This load survey data can be retrieved as and when desired and load profiles shall be viewed graphically / analytically with the help of meter application software. The meter application software shall be capable of exporting / transmitting these data for analysis to other user software in spreadsheet format.

13.00 COMPUTER SOFTWARE.

- 13.01 For efficient and speedy recovery of data downloaded through CMRI on base computer, licensed copies of base computer software shall have to be supplied free of cost. This software will be used at number of places up to Division level. As many copies of base computer software as required up to Division level shall be provided by Supplier.
- 13.02 The meter shall be capable to communicate directly with laptop computer. Base Computer Software shall be suitable for all types of dot matrix & inkjet printers.
- 13.03 The Base Computer Software shall be "Windows" based & user friendly. The data transfer shall be highly reliable and fraud proof (No editing shall be possible on base computer as well as CMRI by any means). The software shall have capability to convert all the data into ASCII format as per MSEDCL requirement.
- 13.04 The Base Computer Software should be password protected.
- 13.05 The total time taken for downloading Billing, Tamper and Load Survey Data for 45 days shall be less than or equal to 8 minutes.
- 13.06 Downloading time of only Billing data as stated above shall be less than 30 secs inclusive of handshaking.
- 13.07 The BCS software shall create one single file for the uploaded data, e.g. if CMRI contains the meter readings of, say, 2,000 consumer meters and the said data is uploaded to BCS, then the BCS shall create a single file containing separate records for each consumer meter reading.
- 13.08 Also there shall be a provision to give filenames while creating the file. Alternatively, the file to be downloaded shall be automatically saved with a file number comprising of Real date, time & downloading activity for respective date. For ex., 170817120501 where, 170817 will denote the date, 1205 will denote the time & 01 will indicate the first downloading activity on that date. this will completely overrule the possibility of file to be overwritten.
- 13.09 As and when the meter manufacturer releases new or latest or advanced versions of meter hardware / firmware / software, the same shall be made available to purchaser immediately on the release date

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

free of cost. The latest version shall support all existing hardware / meters in the field.

13.10 The meter samples shall be tested by our IT Department for the time required for downloading the data as per specifications and as confirmed by the bidder.

13.11 Downloading software shall also be provided so as to install on our Laptop for downloading data directly on Laptop from meter without the use of CMRI.

13.12 The software provided on laptop or PC shall be compatible to read the data directly from USB drive and for that purpose a sample cable (1 No.) shall be provided with USB termination. The length of cable shall be at least 2.5 to 3 meter long.

USB being the de-facto standard, this is the requirement.

13.13 MSEDCL is procuring large quantity of meters. As such manufacturer have to depute Hardware Engineers and Software Engineers on call basis, who shall have thorough knowledge of meter hardware / software used for downloading and converting so as to discuss the problems, if any, or new development in the hardware / software with Chief Engineer, Testing & Quality Control Cell / Chief General Manager (IT), MSEDCL, Prakashgad, Bandra (E), Mumbai – 400051 without any additional charge.

13.14 The data transfer from meter to CMRI & from CMRI to laptop computer or PC shall be highly reliable and fraud proof. (No editing shall be possible on base computer as well as on CMRI by any means).

13.15 This software shall be used at number of places up to Division / Sub Division level. Hence as many copies of base computer software as required up to Division / Sub Division level shall be provided by supplier.

13.16 BCS software shall have the facility to import consumer master data from MSEDCL billing system to BCS. Format is as follows:

- a) BU.
- b) PC.
- c) MR.
- d) Route.
- e) Sequence.
- f) Consumer Number.
- g) Consumer Name.
- h) Consumer Address.
- i) Meter Serial Number.
- j) Meter Make Code.
- k) DTC code.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

13.17 Import / Export shall happen on any USB port & RS - 232 port of PC / Laptop.

13.18 Every report shall have the facility to print/export as text/export as pdf.

13.19 Exporting of meter number from BCS to CMRI shall be selective on meter number or group of meters of particular MR-Route-Sequence or DTC code.

13.20 The software shall have capability to convert all the data into ASCII format as per MSEDCL requirement.

13.21 Billing Data:

SR. NO.	PARAMETERS	OBIS CODE						Interface Class No./ Attribute
		A	B	C	D	E	F	
1.	Total Cumulative Active Energy (kWh) Import including harmonics	1	0	1	8	0	255	3/2
2.	Total Cumulative Active Energy (kWh) Export including harmonics	1	0	2	8	0	255	3/2
3.	Fundamental Cumulative Energy (kWh) Import excluding harmonics	1	65	1	8	0	255	3/2
4.	Fundamental Cumulative Energy (kWh) Export excluding harmonics	1	65	2	8	0	255	3/2

13.22 Load Survey.

As per clause no. 12.02 above

Detail of parameters requirement is given in following tables of document enclosed as annexure II of IS 15959/2011:

Category C3	Parameter group	ANNEX Table No.
LT Consumers Energy Meters	Instantaneous parameters	27
	Block Load Profile parameters	28
	Billing Profile parameters	29
	Name Plate details	30
	Programmable Parameters	31
	Event Conditions	32 to 37

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

13.23 Tamper Data.

S.N.	Name of Tamper Event as per Clause No. 9.00	Occurance date & time	Restoration date & time
1]	Load through local Earth		
2]	Neutral disconnected		
3]	Magnetic Tamper		
4]	Meter cover Open with date & time	Only occurrence	

13.24 BCS shall maintain the downloaded billing history.

13.25 BCS shall store the data to database in encrypted format. Encryption used shall be provided free of cost to MSEDCL.

13.26 Meter manufacturer shall provide API / Exe file with documentation for downloading the data from the meter along with the sample meter.

13.27 Checksum logic shall also be provided for the downloaded data along with the sample meter.

13.28 Checksum checking Exe / API shall also be given for validating downloaded meter data as well as generated XML file with sample meter.

13.29 Tamper data shall be stored in memory and retrieved by CMRI with necessary software.

13.30 API which will be residing on CMRI will be given free of cost with all its documentation and training. Without API, meter samples shall not be approved.

13.31 BCS shall support all current operating system versions and shall provide new version of BCS wherever the new version of operating system released.

13.32 Metering protocol

The meter protocol shall be as per Annex E - Category C3 meters of IS: 15959 / 2011 amended upto date and utility specific OBIS codes for additional parameters mentioned under clause no. 10.06(A), 10.06(B), 12.02 & 13.22 of this specification.

14.00 COMMON METER READING INSTRUMENT (CMRI)

14.01 After starting the CMRI, by default it shall be in Meter Reading mode.

14.02 To enable local reading of meters data, a DLMS compliant CMRI shall be provided.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

- 14.03 The CMRI shall be as per specification given in Annex J of IS: 15959 / 2011.
- 14.04 It shall be compatible to the DLMS compliant energy meters that are to be procured / supplied on the basis of this specification.
- 14.05 The CMRI shall be supplied by the meter manufacturer along with the meter free of cost in the ratio of one for each 100 Nos. meters supplied including user manual and a set of direct communication cords for data downloading to the Laptop or PC for each CMRI.
- 14.06 There shall be a provision for auto power save on CMRI, which shall force the instrument in the power saving mode in case of no-activity within 5 minutes.
- The data shall not be lost in the event the batteries are drained or removed from the CMRI.
- 14.07 The CMRI shall have a memory capacity of 8 MB SRAM (Static RAM) with battery backup & upgradeable and BIOS / OS on FLASH / EEPROM Memory of 256 KB.
- 14.08 The manufacturer / supplier shall modify the compatibility of CMRI with the meter and the base computer system due to any change in language or any other reasons at their own cost within guarantee period.
- 14.09 The CMRI shall be type tested for (a) Tests of Mechanical requirement such as Free fall test, Shock Test, Vibration test, (b) Tests of Climatic influences such as Tests of Protection against Penetration of Dust and Water (IP 6X), Dry Heat test, Cold Test, Damp Heat Cyclic Test, (c) Tests for Electromagnetic Compatibility (EMC), (d) Test of Immunity to Electromagnetic HF Fields and (e) Radio Interference Measurement.
- 14.10 The equipments offered shall be fully type tested at approved laboratory by National Accreditation Board for Testing and Calibration Laboratories (NABL) as per relevant standards within last 5 years from the date of opening of tender & the type test reports shall be enclosed with the offer.
- 14.11 The CMRI shall possess a specific Serial No. which cannot be changed. Every CMRI shall be properly labeled with serial number/tender number/program name/program version.
- 14.12 There shall be test option for just checking the connectivity between CMRI and meter.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

- 14.13 The CMRI shall be supplied including user manual, AA size batteries and a set of direct communication cords for data downloading to the Laptop or PC for each CMRI.
- 14.14 The CMRI shall be capable to download following data individually after respective command to CMRI.
- (a) Only Billing Data,
 - (b) Only Billing History,
 - (c) Only Tamper Data,
 - (d) Only Load Survey Data,
 - (e) All Data (All data should be inclusive of above mentioned (a)+(b)+(c)+(d)+Instantaneous data.)
- 14.15 CMRI shall be capable of downloading billing data of at least 2,000 (Two thousand) meters at a time.
- 14.16 The meter specific MRI programs shall have the ability to use CMRI real time clock to tag all time related events.
- 14.17 A real time clock shall be provided in the CMRI. The clock shall have a minimum of 15 days battery backup with 30 year calendar. The time drift of the real time clock, considering all influencing quantities shall not exceed + / - 300 seconds per year.
- 14.18 After successful downloading of meter data to CMRI, an indication on CMRI for confirmation of successful data transfer shall be provided for each set of data, viz. billing, load survey & tamper data.
- 14.19 CMRI shall not accept any external file other than BCS.
- 14.20 After downloading the data from meters, it shall be possible to create a single file for all records. The contents of this file shall not be editable.
- 14.21 Further, there shall be facility in CMRI to provide the transfer of meter data to base computer through RS 232 port as well as USB port.
- 14.22 The interface cable for communication between CMRI & Base computer shall be supplied free of cost. One no. of chords of minimum length of 1 mtr. shall be provided with each CMRI for downloading the data from CMRI to base computer.
- 14.23 The manufacturer / supplier shall modify the compatibility of CMRI with the meter and the base computer system due to any change in language or any other reasons at their own cost within guarantee period.
- 14.24 The CMRI shall have facility for re-entering the meter serial numbers directly from base computer system so that once these meters are read and the data is uploaded on base computer system, the serial numbers of existing meters could be deleted from the CMRI and the meter serial numbers of other meters can be entered in the CMRI.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

- 14.25 CMRI shall download the data of all the meters, irrespective of meter serial number present in CMRI.
- 14.26 While exporting the fresh (new) meter data from BCS to CMRI, there shall have the option for downloading or deleting the old data present in CMRI.
- 14.27 Before deleting the data from CMRI ask (prompt) (Yes/No) twice the user for confirmation to delete the data.
- 14.28 The CMRI shall be type tested for (a) Tests of Mechanical requirement such as Free fall test, Shock Test, Vibration test, (b) Tests of Climatic influences such as Tests of Protection against Penetration of Dust and Water (IP 6X), Dry Heat test, Cold Test, Damp Heat Cyclic Test, (c) Tests for Electromagnetic Compatibility (EMC), (d) Test of Immunity to Electromagnetic HF Fields and (e) Radio Interference Measurement.
- 14.29 The equipments offered shall be fully type tested at approved laboratory by National Accreditation Board for Testing and Calibration Laboratories (NABL) as per relevant standards within last 5 years from the date of opening of tender & the type test reports shall be enclosed with the offer.

15.00 CONNECTION DIAGRAM AND TERMINAL MARKINGS

The connection diagram of the meter shall be clearly shown on inside portion of the terminal cover and shall be of permanent nature.

Meter terminals shall also be marked and this marking shall appear in the above diagram. **Stickers of any kind shall not be accepted.**

16.00 NAME PLATE AND MARKING

Meter shall have a name plate clearly visible, effectively secured against removal and indelibly and distinctly marked with all essential particulars as per relevant standards. The manufacturer's meter constant shall be marked on the Name Plate.

In addition to the requirement as per IS, following shall be marked on the Name Plate.

Purchase Order No.

Month and Year of manufacture

Name of purchaser: MSEDCL

Guarantee Five Years

ISI mark

The meter Serial No. shall be Bar Coded along with Numeric No. The size of Bar Code shall not be less than 35x5 mm. Stickers in any case shall not be accepted.

17.00 TESTS

17.01 TYPE TESTS

Meter shall be fully type tested as per IS: 13779 / 1999 (amended up to date) and external AC / DC magnetic influence tests as per CBIP Tech-Report 325 with latest amendments. The Type Test Reports shall clearly indicate the constructional features of the type tested meters. Separate Type Test Reports for each offered type of meters shall be submitted. All the Type Tests shall have been carried out from Laboratories which are accredited by the National Board of Testing and Calibration Laboratories (NABL) of Govt. of India such as CPRI, Bangalore / Bhopal, ERDA Vadodara, ETDC, ERTL to prove that the meters meet the requirements of the specification.

Type Test Reports conducted in manufacturers own laboratory and certified by testing institute shall not be acceptable.

Type test reports shall be submitted along with offer. The type test report of meter having identical constructional and other features carried out during last three years shall be valid. The purchaser reserves the right to demand repetition of some or all the type tests in presence of purchaser's representative at purchaser's cost.

17.02 Meters shall pass the entire acceptance and routine tests as laid down in IS: 13779 / 1999 (amended up to date) and also additional acceptance tests as prescribed in this specification. (3 to 8 meters from a lot more than 1,000 shall be sealed randomly in the factory and shall be tested for tamper events).

17.03 ADDITIONAL ACCEPTANCE TESTS

The following additional tests shall be carried out in addition to the acceptance tests specified in IS: 13779 / 1999 (amended up to date).

All additional acceptance test shall be carried out during quality testing as per tender condition.

i. **Transportation Test**

At least 50% of the samples of the meters be tested for error at I_{max} , I_b and 5% I_b at unity power factor and 50% I_{max} and 10% I_b at 0.5 lagging Power Factor besides checking them for starting current. The meter shall be tested with meter cover duly tightened and sealed properly.

After recording these errors, the meters be put in their normal packing and transported for at least 50 km in any transport vehicle such as pick up van, Jeep, etc. on uneven rural roads and then re-tested at all these loads after the transportation.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

The variation in errors recorded before and after transportation shall not exceed 1% at higher loads and 1.5% at low loads.

ii. Other Acceptance Tests

- i) The meter shall withstand continuously for a period of at least 5 minutes at a voltage of 440 V between phase and neutral without damage / problems,
- ii) Tamper conditions as stated in this specification,
- iii) Glow wire testing for polycarbonate material.
- iv) Power consumption tests,
- v) Verification of data transfer / downloading via RF port as per technical specifications,
- vi) The meter shall comply all the tests for external AC / DC (except 0.2 Tesla AC magnet test) magnetic field as per CBIP Tech Report 88 with latest amendments.

Moreover, the magnetic influence test for permanent magnet of 0.5 Tesla for a minimum period of 15 minutes shall be carried out by putting the magnet on the meter body.

If the accuracy of the meter gets affected during the test, then the same shall be recorded as magnetic tamper event with date & time stamping and the meter shall record energy considering maximum value current (I_{max}) and reference voltage at unity power factor.

After removal of magnet, meter shall be subjected to accuracy test as per IS 13779 / 1999 (amended up to date).

No deviation in error is allowed in the class index as per IS: 13779 / 1999 (amended up to date) & this specification.

- vii) The meter shall withstand impulse voltage at 10 kV.
- viii) The meter shall remain immune for the test of electromagnetic HF/RF defined under the test no. 4.0 for EMI/EMC of IS 13779:1999 amended up to date. For any higher signals than the present standards and MSEDCL technical specifications indicated above, the energy meters shall be immune & the accuracy of meter shall not get affected.

Jammer Test shall be carried out at MSEDCL testing Division lab.

The tests 17.03.(ii) (i) to (v) shall be carried out at factory for each inspected lot at the time of pre-dispatch inspection.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

The tests 17.03.(ii) (vi) to (viii) shall be carried out on one sample from first lot as per procedure laid down in IS: 13779 / 1999 (amended up to date) and CBIP Tech. Report 325 in NABL LAB.

The test report shall be got approved from Chief Engineer, MSEDCL, Testing & Quality Control Cell, 1st Floor, Prakashgad, Bandra (E), Mumbai – 400 051 before commencement of supply.

17.04 LIMITS OF ERROR

Limits of variation in percentage error due to change in voltage shall not exceed the values given in the following table:

Sr. No.	Influence quantities	current Value	Power factor	Limits of variation in % error for class 1 meters
a)	Voltage variation – 15% to +10%	I _b	1	0.7
		I _b	0.5 lag	1.0
b)	Voltage variation – 40% & + 20%	I _b	1	1.1
		I _b	0.5 lag	1.5

i) The meters shall be tested at (-) 15% and at (-) 40% of reference voltage as well as (+) 10% and (+) 20% of reference voltage and shall record energy within limits of variation indicated above.

ii) For other influence quantities like frequency variation the limits of variation in percentage error shall be as per IS: 13779 / 1999 (amended up to date).

18.00 GUARANTEED TECHNICAL PARTICULARS

The tenderer shall furnish the particulars giving specific required details of Meter in schedule 'A' attached. The offers without the details in Schedule 'A' stands rejected.

19.00 PRE DESPATCH INSPECTIONS

All Acceptance Tests and Inspection shall be carried out at the place of manufacturer unless otherwise specially agreed upon by the manufacturer and purchaser at the time of purchase. The manufacturer shall offer to the inspector representing the purchaser, all the reasonable facilities, free of charge, for inspection and testing, to satisfy him that the material is being supplied in accordance with this specification. The Company's representative / Engineer attending the above testing shall carry out testing on suitable number of meters as per sampling procedure laid down in IS: 13779 / 1999 (amended up to date) and additional acceptance test as per this specification and issue test

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

certificate approval to the manufacturer and give clearance for dispatch. All the meters offered for inspection shall be in sealed condition. The seals of sample meters taken for testing & inspection shall be break open & resealed after inspection. The first lot of meter may be jointly inspected by the Executive Engineer, Testing Division and the Executive Engineer, Inspection Wing.

20.00 INSPECTION AFTER RECEIPT AT STORES (Random Sample Testing)

For carrying out Random Sample Testing (RST), the sample meters shall be drawn from any one of the stores against inspected lot and same shall be tested at respective Testing and Quality Assurance Units at Aurangabad, Bhandup, Kolhapur, Nagpur, Nashik and Pune. Sample meters shall be drawn as per Annex H of IS: 13779 / 1999 (amended upto date). Sample meters shall be tested by MSEDCL Testing Engineer in presence of supplier's representative jointly for (i) Starting Current, (ii) Limits of error, (iii) Repeatability of error, (iv) No Load Test as per IS: 13779/1999 (amended upto date), (v) Tamper conditions as per technical specifications and (vi) Data downloading time as per specifications.

The 5 days advanced intimation shall be given to the supplier and if the supplier fails to attend the joint inspection on the date informed, the testing shall be carried out by our Testing Engineer in absence of supplier's representative. If the meters failed in above Random Sample Testing, the lot shall be rejected.

21.00 GUARANTEE.

The meter & CMRI shall be guaranteed for the period of five years from the date of commissioning or five and half year from the date of dispatch whichever is earlier. The meter / CMRI found defective within above guarantee period shall be replaced by the supplier free of cost, within one month of receipt of intimation. If defective meter / CMRI is not replaced within the specified period as above, the Company shall recover an equivalent amount plus 15% supervision charges from any of the bills of the supplier.

22.00 PACKING

22.01 The meters shall be suitably packed in order to avoid damage during transit or handling. Each meter may be suitably packed in the first instance to prevent ingress of moisture and dust and then placed in a cushioned carton of a suitable material to prevent damage due to shocks during transit. The lid of the carton may be suitably sealed. A suitable number of sealed cartons may be packed in a case of adequate strength with extra cushioning. The cases may then be properly sealed against accidental opening in transit. The packing cases may be marked to indicate the fragile nature of the contents.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

22.02 The following information shall be furnished with the consignment:

- Name of the consignee.
- Details of consignment.
- Destination.
- Total weight of the consignment.
- Sign showing upper / lower side of the crate.
- Sign showing fragility of the material.
- Handling and unpacking instructions.
- Bill of Material indicating contents of each package and spare material.

23.00 TENDER SAMPLE

Tenderer are required to submit 15 (Fifteen) nos. of sample meters and 1 (One) no. of sample CMRI of offered type as per technical specifications along with the API software, BCS, checksum logic & documentation to Executive Engineer (Store Management) in the office of the Chief Engineer, MSEDCL, Material Management Cell, 1st Floor, Prakashgad, Bandra (E), Mumbai – 400 051 on or before the time & date stipulated for submission of offer for testing the sample meters in third party NABL Lab like ERDA, CPRI, CIPET, ERTL, ETDC and testing the offered API with BCS software, checksum logic & documentation by our IT Department as per technical specifications for testing, etc. The offer of those eligible bidders shall only be considered if the sample passes the tests at NABL Lab as well as necessary certification from our IT Department for the offered API, etc. The results of NABL Lab and the certification from IT Department shall not be disputed and shall be binding on the bidder. The required information such as Manufacturer's Name or Trade Name, Sr. No. ISI Certification No. API specification no., etc. shall be on stickers to be affixed on outer portion of sample meters being submitted along with the offer. Such information shall not be embossed or printed on any part of the sample meter.

Out of these, two samples shall be without ultrasonic / laser welding to confirm constructional features.

24.00 QUALITY CONTROL

24.01 The purchaser has a right to send a team of experienced engineers for assessing the capability of the firm for manufacturing and testing of meters as per this specification. The team shall be given all assistance and co-operation for inspection and testing at the bidder's works.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

24.02 The meters supplied shall give service for a long period with out drifting from the original calibration & performance must be near to zero percent failure.

25.00 MINIMUM TESTING FACILITIES

Manufacturer shall possess fully computerized Meter Test Bench System for carrying out routine and acceptance Tests as per IS: 13779/1999 (amended up to date). Test Reports for each and every meter shall be generated. The list of testing equipments shall be enclosed.

The manufacturer shall have the necessary minimum testing facilities for carrying out the following tests:

- (i) Insulation resistance measurement,
- (ii) No load condition,
- (iii) Starting current,
- (iv) Accuracy requirement,
- (v) Power consumption,
- (vi) Repeatability of error,
- (vii) Transportation test – as per clause no. 17.03.(i),
- (viii) Tamper conditions - as per clause no. 10.00,
- (ix) The manufacturer shall have duly calibrated RSS meter of class 0.1 or better accuracy.
- (x) The manufacturer shall have Glow Wire Testing facility.
- (xi) The bidder shall have fully automatic Test Bench having in-built constant voltage, current and frequency source with facility to select various loads automatically and print the errors directly.

26.00 MANUFACTURING ACTIVITIES

The manufacturer shall submit the list of plant and machinery along with the offer.

- i) Meter shall be manufactured using SMT (Surface Mount Technology) components and by deploying automatic SMT pick and place machine and reflow solder process. The loops/wired joints must be avoided on PCB. Further, the Bidder shall own or have assured access (through hire, lease or sub-contract, documentary proof shall be attached with the offer) of above facilities.
- ii) Quality shall be ensured at the following stages:
 - At PCB manufacturing stage, each Board shall be subjected to computerized bare board testing.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

- At insertion stage, all components shall undergo computerized testing for conforming to design parameters and orientation.
 - Complete assembled and soldered PCB shall undergo functional testing using Automatic Test Equipments (ATEs).
 - Important: - Prior to final testing and calibration, all meters shall be subjected to ageing test (i.e. Meters shall be kept in heating chamber for 72 hours at 55°C temperature at full load current. After 72 hours, meters shall work satisfactory) to eliminate infant mortality.
- iii) The calibration of meters shall be done in-house on a computerized testing bench having stabilized power supply.
- iv) The bidders shall submit the list of all (imported as well as indigenous) components to be used in meter, separately along with the offer. List of makes of components is attached herewith as a guide line (Annexure II).
- v) Bought out items:
A detailed list of bought out items which are used in the manufacturing of the meter shall be furnished indicating the name of firms from whom these items are procured. The bidder shall also give the details of quality assurance procedures followed by him in respect of the bought out items.
- vi) List of Plant and Machinery used for production of energy meters.

Sr. No.	List of Plant and Machinery used for Energy meter Production	
1	Fully automatic testing Bench with ICT for testing link less meters	Routine Testing and Calibration of Meters
2	Semi automatic testing Bench with MSVT	Routine Testing and Calibration of Meters
3	IR Tester	Insulation testing
4	HV Tester	Insulation testing
5	Error calculators	Error testing
6	Long duration Running test set ups	Reliability Testing
7	Reference Meters class 0.1 accuracy	Error calculation
8	Ultrasonic welding Machines	Welding of meters

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

9	Automatic Pick and Place Machines	Automatic placing of SMT components
10	Solder Paste Printing Machine	SMT soldering
11	Soldering Furnace IR reflow	SMT soldering
12	PCB Scanner	For testing of PCBs
13	ATE functional tester	For testing of Components
14	Programmiers and Program Loaders	Chip Programming Tools
15	CAD PCB designing setups	PCB designing
16	Furnace IR type for Hybrid Micro Circuits	resistance network and HMC manufacturing
17	Laser Trimming Machines	trimming of resistances for higher accuracy measurement
18	Wave Soldering Machines	Wave soldering of PCBs
19	Humidity Chamber	Accelerated testing for Life cycle
20	Dry Heat Test Chamber	Accelerated testing for Life cycle
21	Thermal Shock Chamber	Accelerated testing for Life cycle
22	PRO E-Mechanical Design Stations	Mechanical CAD stations
23	Spark Erosion Tool fabricating Machine	Tool fabrication and Die manufacturing
24	CNC wire Cut Tool Fabrication machine	Tool fabrication and Die manufacturing
25	Injection Moulding Machine	Moulding of plastic parts
26	CNC Milling Machine for composite tool fabrication	Tool fabrication and Die manufacturing
27	Vibration testing Machine	Vibration testing of Meters
28	Glow Wire Test machine	Testing of Plastic Material

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

29	Fast transient burst testing setup	Type testing of Meters
30	Short term over Current testing setup	Type testing of Meters
31	Magnetic and other tamper testing setups	Tamper Testing
32	Impulse Voltage Testing Setup	Type testing of Meters
33	Composite Environmental testing chambers	Type testing of Meters

27.00 QUALITY ASSURANCE PLAN

27.01 The tenderer shall invariably furnish QAP as specified in Annexure-I along with his offer the QAP adopted by him in the process of manufacturing.

27.02 Precautions taken for ensuring usage of quality raw material and sub component shall be stated in QAP.

28.00 COMPONENT SPECIFICATION

As per Annexure II enclosed.

29.00 SCHEDULES

The tenderer shall fill in the following schedules and submit along with the offer. If the schedules are not submitted duly filled in with the offer, the offer shall be rejected.

Schedule 'A' ... Guaranteed Technical particulars (As per GTP parameters uploaded on e- Tendering site.)

The discrepancies, if any, between the specification and the catalogs and/or literatures submitted as part of the offer by the bidders, shall not be considered and representations in this regard will not be entertained. If it is observed that there are deviations in the offer in Guaranteed Technical Particulars other than those specified in the deviation schedules then such deviations shall be treated as deviations.

ANNEXURE I

Quality Assurance Plan

- A) The bidder shall invariably furnish the following information along with his bid, failing which his bid shall be liable for rejection. Information shall be separately given for individual type of material offered.
- i) Statement giving list of important raw materials, names of sub - suppliers for the raw materials, list of standards according to which the raw materials are tested. List of tests normally carried out on raw materials in presence of Bidder's representative, copies of test certificates,
 - ii) Information and copies of test certificates as in (i) above in respect of bought out accessories,
 - iii) List of manufacturing facilities available,
 - iv) Level of automation achieved and list of areas where manual processing exists,
 - v) List of areas in manufacturing process, where stage inspections are normally carried out for quality control and details of such tests and inspections,
 - vi) List of testing equipments available with the bidder for final testing of equipment specified and test plan limitation, if any, vis-à-vis, the type, special acceptance and routine tests specified in the relevant standards. These limitations shall be very clearly bought out in schedule of deviation from specified test requirements.
- B) The successful bidder shall within 30 days of placement of order, submit following information to the purchaser.
- i) List of raw materials as well as bought out accessories and the names of sub - suppliers selected from those furnished along with offers.
 - ii) Type test certificates of the raw materials and bought out accessories if required by the purchaser.
 - iii) Quality assurance plan (QAP) with hold points for purchaser's inspection. The quality assurance plant and purchasers hold points shall be discussed between the purchaser and bidder before the QAP is finalized.
- C) The contractor shall operate systems which implement the following:
- i) Hold point: A stage in the material procurement or workmanship process beyond which work shall not proceed without the documental approval of designated individuals organizations. The purchaser's written approval is

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

required to authorize work to progress beyond the hold points indicated in quality assurance plans.

- ii) Notification point: A stage in the material procurement or workmanship process for which advance notice of the activity is required to facilitate witness. If the purchaser does not attend after receiving documented notification in accordance with the agreed procedures and with the correct period of notice, then the work may proceed.

D) The successful bidder shall submit the routine test certificates of bought out accessories and central excise passes for raw material at the time of routine testing if required by the purchaser and ensure that Quality Assurance program of the contractor shall consist of the quality systems and quality plans with the following details.

- i) The structure of the organization.

- > The duties and responsibilities assigned to staff ensuring quality of work.
- > The system for purchasing taking delivery and verification of material.
- > The system for ensuring quality workmanship.
- > The system for retention of records.
- > The arrangement for contractor's internal auditing.
- > A list of administration and work procedures required to achieve and verify contractor's quality requirements.

These procedures shall be made readily available to the project manager for inspection on request.

- ii) Quality Plans:

- > An outline of the proposed work and programme sequence.
- > The structure of the contractor's organization for the contract.
- > The duties and responsibilities assigned to staff ensuring quality of work.
- > Hold and notification points.
- > Submission of engineering documents required by the specification.
- > The inspection of materials and components on receipt.
- > Reference to the contractor's work procedures appropriate to each activity.
- > Inspection during fabrication / construction.
- > Final inspection and test.

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

ANNEXURE II

COMPONENT SPECIFICATION

SN	Component Function	Requirement	Makes & Origin
1.	Measurement or computing chips	The measurement or computing chips used in the Meter shall be with the Surface mount type along with the ASICs.	<p>USA: Teridian, Analog Devices, Cyrus Logic, Atmel, Philips, Dallas, ST, Motorola, Texas Instruments, Maxim, Freescale, National Semiconductor, Onsemiconductors.</p> <p>Germany: Siemens.</p> <p>South Africa: SAMES.</p> <p>Japan: NEC, Toshiba, Renasas, Hitachi.</p> <p>Austria: AMS.</p> <p>Holland: Philips (N X P)</p> <p>Taiwan: Prolific</p>
2.	Memory chips	<p>Memory chips shall not be affected by external parameters like sparking, high voltage spikes or electrostatic discharges.</p> <p>Meter shall have nonvolatile memory (NVM). No other type of memory shall be used for data recording and programming. (The life of the NVM is highest). There shall be security isolation between metering circuit, communication circuit, and power circuit.</p>	<p>USA: Teridian, Atmel, Philips, ST, National Semiconductors, Texas Instruments, Microchip, Spanson (Fujitsu), Ramtron.</p> <p>Japan: Hitachi, Renasas.</p> <p>Germany: Siemens</p>
3.	Display modules	The display modules shall be well protected from the external UV radiations.	<p>Singapore: Bonafied Technologies, Displaytech, E-smart</p> <p>Korea: Advantek,</p>

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

		<p>The display visibility shall be sufficient to read the Meter mounted at a height of 0.5 meter as well as at the height of 2 meters (refer 3.2 d for viewing angle).</p> <p>The construction of the modules shall be such that the displayed quantity shall not disturb with the life of display (PIN Type).</p> <p>It shall be Tran-reflective HTN or STN type industrial grade with extended temperature range.</p>	<p>Jebon, Union Display Inc.</p> <p>Hong Kong: Genda</p> <p>China: Success, Truly, Success.</p> <p>Japan: Hitachi, Sony, L & G.</p> <p>Malaysia: Crystal Clear Technology.</p>
4.	Communication Modules	<p>Communication modules shall be compatible for the two ports (one for Optical port for communication with meter reading instruments (CMRI) & the other for the hardwired RS-232 port to communicate with various modems for AMR)</p>	<p>USA: Agilent, HP, Fairchild, National Semiconductors, Optonica.</p> <p>Holland: Philips.</p> <p>Korea: Phillips.</p> <p>Japan: Hitachi.</p> <p>Taiwan: Ligitek</p>
5.	Optical port	<p>Optical port shall be used to transfer the meter data to meter reading instrument.</p> <p>The mechanical construction of the port shall be such to facilitate the data transfer easily.</p>	<p>USA: HP, National Semiconductors, Maxim</p> <p>Holland/Korea: Phillips</p> <p>Japan: Hitachi</p> <p>Taiwan: Ligitek</p>
6.	Power supply	<p>The power supply shall be with the Capabilities as per the relevant standards. The power supply unit of the meter shall not be affected in case the maximum voltage of the system appears to the terminals</p>	<p>SMPS Type</p>

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

		due to faults or due to wrong connections. It shall not also be affected by magnet	
7.	Electronic Components	The active & passive components shall be of the surface mount type & are to be handled & soldered by the state of art assembly processes.	<p>USA: Atmel, National Semiconductors, BC Component, Philips, Texas Instruments, Analog Devices. ST, Onsemiconductors, Maxim, Muruta, Kemet, Freescale, AVX, Intersil, Raltron, Fox, Fairchild, Agilent, Abracon, Diode Inc., Honeywell, Sipex Power Integration, Roham.</p> <p>Japan: Hitachi, Oki, AVZ, Ricon, Toshiba, Epson, Kemet, Alps, Muruta, TDK, Sanyo, Samsung.</p> <p>India: RMC, VEPL, KELTRON, Incap, PEC, Cermet, Gujarat Polyavx, Prismatic, MFR Electronic Components Pvt. Ltd, CTR</p> <p>Korea: Samsung</p> <p>Japan: Panasonic</p> <p>Germany: Kemet, Vishay, Epcos, Diotech, Infenion.</p> <p>Taiwan: Yageo</p>
8.	Mechanical parts	<p>The internal electrical components shall be of electrolytic copper & shall be protected from corrosion, rust etc.</p> <p>The other mechanical components shall be protected from rust, corrosion etc. by suitable</p>	

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

		plating / painting methods.	
9.	Battery	Maintenance free battery (Ni-mh or Li-ion) of long life of 15 years. Only non-rechargeable battery shall be used for RTC as well as display in absence of Power since the life & Reliability of these are better than the rechargeable batteries.	USA: Varta, Tedirun, Sanyo or National, Maxell, Renata. Japan: Panasonic, Sony, Mitubhushi. France: Saft. Korea: Tekcell. Germany: Varta.
10.	RTC & Micro controller.	The accuracy of RTC shall be as per relevant IEC / IS standards.	USA: ST, Teridian, Philips, Dallas, Atmel, Motorola, Microchip. Japan: NEC, Oki, Epson.
11.	P.C.B.	Glass Epoxy, fire resistance grade FR4, with minimum thickness 1.6 mm.	

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

SCHEDULE 'A'

GUARANTEED TECHNICAL PARAMETERS

ITEM NAME: LT AC SINGLE PHASE 5 – 30 AMPS. STATIC ENERGY METER WITH IR PORT FOR COMMUNICATION		
SR. NO.	GUARANTEED TECHNICAL PARAMETERS	GTP VALUES
1.0	MAKE & TYPE	TEXT
2.0	APPLICABLE STANDARD	TEXT
3.0	ACCURACY CLASS	TEXT
4.0	METER BEARS ISI MARK (YES/NO)	BOOLEAN
5.0	RATED VOLTAGE	TEXT
6.0	VOLTAGE RANGE (-) 40% TO (+) 20% OF RATED VOLTAGE (YES/NO)	TEXT
7.0	FREQUENCY	TEXT
8.0	RATED BASIC CURRENT	TEXT
9.0	MAXIMUM CURRENT I _{MAX} 30 AMP (YES/NO)	BOOLEAN
10.0	STARTING CURRENT 0.2 % OF I _B . (YES/NO)	BOOLEAN
11.0	POWER CONSUMPTION IN VOLTAGE CIRCUIT	TEXT
12.0	POWER CONSUMPTION IN CURRENT CIRCUIT	TEXT
13.0	POWER FACTOR ZERO TO UNITY (ALL LAG OR LEAD) (YES/NO)	TEXT
14.0	STANDARD REFERENCE TEMPERATURE FOR PERFORMANCE	TEXT
15.0	MEAN TEMPERATURE CO-EFFICIENT DOES NOT EXCEED 0.07% (YES/NO)	BOOLEAN
16.0	TEMPERATURE RISE IS AS PER IS: 13779 / 1999 (AMENDED UP TO DATE) (YES/NO)	BOOLEAN

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

17.0	METER BASE & COVER MADE OF UNBREAKABLE, TOUGH, HIGH GRADE, FIRE RESISTANT TRANSPARENT POLYCARBONATE MATERIAL (YES/NO)	BOOLEAN
18.0	METER BODY TYPE TESTED FOR DEGREE OF INGRESS PROTECTION AS PER IS 12063 (YES/NO)	TEXT
19.0	FURNISH PHYSICAL WATER ABSORPTION VALUE	TEXT
20.0	FURNISH THERMAL HDDT VALUE	TEXT
21.0	FLAMMABILITY V2 (YES/NO)	BOOLEAN
22.0	FURNISH FLAMMABILITY VALUE	TEXT
23.0	GLOW WIRE TEST AT 650° C	TEXT
24.0	TENSILE STRENGTH	TEXT
25.0	FLEXURE STRENGTH	TEXT
26.0	MODULUS OF ELASTICITY	TEXT
27.0	IZOD IMPACT STRENGTH NOTCHED AT 23° C	TEXT
28.0	FURNISH PHYSICAL WATER ABSORPTION VALUE	TEXT
29.0	MOULDED TERMINAL BLOCK CONFORMS TO IS: 13779 / 1999 (AMENDED UP TO DATE) (YES/NO)	BOOLEAN
30.0	EXTENDED TRANSPARENT TERMINAL COVER AS PER CLAUSE NUMBER 6.5.2 OF IS: 13779 / 1999 (AMENDED UP TO DATE) IS PROVIDED (YES/NO)	BOOLEAN
31.0	TRANSPARENT TERMINAL COVER IS SEALABLE INDEPENDENTLY (YES/NO)	BOOLEAN
32.0	PROPER SIZES OF GROOVES ARE PROVIDED AT BOTTOM OF TERMINAL COVER (YES/NO).	BOOLEAN
33.0	METER BASE & COVER ARE ULTRA-SONICALLY WELDED (CONTINUOUS WELDING) (YES/NO).	BOOLEAN
34.0	THICKNESS OF MATERIAL FOR METER	TEXT
35.0	RTC PRE-PROGRAMMED FOR 30 YEARS DAY / DATE (YES/NO)	BOOLEAN

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

36.0	TIME ACCURACY OF RTC AS PER CBIP TECH REPORT 304 (YES/NO)	TEXT
37.0	PROVISION TO PUT AT LEAST TWO SEALS BY UTILITY USER (YES/NO)	BOOLEAN
38.0	PUSH BUTTON PROVIDED FOR SCROLLING THE PARAMETERS IN ALTERNATE DISPLAY (ON DEMAND) MODE (YES/NO)	BOOLEAN
39.0	OPERATION INDICATOR PROVIDED IN THE FORM OF BLINKING LED	TEXT
40.0	METER CONSTANT INDELIBLY PROVIDED ON THE NAMEPLATE (YES/NO)	BOOLEAN
41.0	METER ACCURACY DOES NOT GET AFFECTED BY MAGNETIC FIELD FROM ALL SIDES OF THE METER (YES/NO)	BOOLEAN
42.0	ONE CT IN NEUTRAL CIRCUIT AND ONE MANGANIN BASED, E-BEAM WELDED SHUNT IN PHASE CIRCUIT PROVIDED (YES/NO)	BOOLEAN
43.0	METER WITHSTANDS PHASE TO PHASE VOLTAGE (440 V) IF APPLIED BETWEEN PHASE TO NEUTRAL FOR MINIMUM 5 MIN (YES/NO)	BOOLEAN
44.0	POWER SUPPLY UNIT IS TRANSFORMER LESS (YES/NO)	BOOLEAN
45.0	COMPLETE METERING SYSTEM & MEASUREMENT NOT AFFECTED BY EXTERNAL ELECTROMAGNETIC INTERFERENCE (YES/NO)	BOOLEAN
46.0	METER MEETS THE REQUIREMENT OF CBIP TECH. REPORT 88 (AMENDED UP TO DATE) EXCEPT 0.2 TESLA AC MAGNET TEST (YES/NO)	BOOLEAN
47.0	METER ACCURACY DOES NOT GET INFLUENCED BY INJECTION OF HIGH FREQUENCY AC VOLTAGE / CHOPPED SIGNAL / DC SIGNAL AND HARMONICS ON THE TERMINALS OF THE METER (YES/NO)	BOOLEAN
48.0	METER RECORDS AND DISPLAY TOTAL ENERGY (YES/NO).	BOOLEAN
49.0	METER DISPLAYS UNSATISFACTORY FUNCTIONING OR NONFUNCTIONING OF REAL TIME CLOCK BATTERY (YES/NO)	BOOLEAN

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

50.0	METER PCB IS WIRELESS (YES/NO)	BOOLEAN
51.0	BATTERY BACK UP WITH MINIMUM 10 YEARS LIFE IS PROVIDED (YES/NO)	BOOLEAN
52.0	METER DISPLAYS DEFAULT PARAMETERS ONLY ONCE AFTER ACTIVATION OF BATTERY DURING POWER OFF CONDITION (YES/NO)	BOOLEAN
53.0	BATTERY GETS LOCKED AFTER 3 OPERATIONS DURING ONE POWER OFF CYCLE (YES/NO)	BOOLEAN
54.0	35 KV SPARK DISCHARGE TEST OF IS CARRIED OUT (YES/NO)	BOOLEAN
55.0	METER MANUFACTURED USING SMT (YES/NO)	BOOLEAN
56.0	ALL ANTI-TAMPER FEATURES AS PER SPECIFICATION	BOOLEAN
57.0	PERMANENT BACKLIT LCD TYPE DISPLAY IS PROVIDED (YES/NO)	BOOLEAN
58.0	5 NUMBER OF DIGITS FOR ENERGY DISPLAY PROVIDED (YES/NO).	BOOLEAN
59.0	MINIMUM SIZE OF DIGITS IS 9X5 MM (YES/NO).	BOOLEAN
60.0	DEFAULT DISPLAY SWITCHES TO ALTERNATE DISPLAY AFTER PRESSING PUSH BUTTON CONTINUOUSLY FOR 5 SECONDS (YES/NO).	BOOLEAN
61.0	ALTERNATE DISPLAY SWITCHES TO DEFAULT DISPLAY IF PUSH BUTTON IS NOT OPERATED FOR 15 SECONDS (YES/NO).	BOOLEAN
62.0	ACTIVE CUMULATIVE ENERGY (KWH) IS DISPLAYED FOR 20 SECONDS (YES/NO)	BOOLEAN
63.0	OTHER PARAMETERS THAN CUMULATIVE ENERGY AND ALTERNATE MODE PARAMETERS DISPLAYED FOR MINIMUM 6 SECONDS (YES/NO)	BOOLEAN
64.0	LCD CHECK IS PROVIDED TO DISPLAY HEALTHINESS OF ALL SEGMENTS (YES/NO)	BOOLEAN
65.0	KWMD PROVIDED (YES/NO)	BOOLEAN

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

66.0	MD INTEGRETION PERIOD CAN BE SET AT 15 MINUTE OR 30 MINUTE REAL TIME BASED AS PER REQUIREMENT (YES/NO)	TEXT
67.0	MD AUTO RESETS AT 24:00 HRS AT THE END OF EACH BILLING CYCLE OR AT THE END OF CERTAIN PREDEFINED PERIOD (YES/NO)	BOOLEAN
68.0	METER PRE-PROGRAMMED FOR (a) VOLTAGE	TEXT
69.0	(b) INTEGRATION PERIOD OF KWMD	TEXT
70.0	(c) AUTO RESET KWMD AT 2400 HRS. OF LAST DAY OF EACH CALENDAR MONTH (YES/NO)	BOOLEAN
71.0	(d) NO RESET PUSH BUTTON PROVIDED (YES/NO)	BOOLEAN
72.0	(e) DEFAULT DISPLAY (AUTO SCROLLING MODE) SWITCHES TO ALTERNATE DISPLAY (ON DEMAND DISPLAY MODE) AFTER PRESSING PUSH BUTTON CONTINUOUSLY FOR 5 SECONDS (YES/NO)	BOOLEAN
73.0	(f) ALTERNATE DISPLAY SWITCHES OVER TO DEFAULT DISPLAY IF PUSH BUTTON IS NOT OPERATED FOR 15 SECONDS (YES/NO)	BOOLEAN
74.0	NON-VOLATILE MEMORY OF 10 YEARS PROVIDED (YES/NO)	BOOLEAN
75.0	CMRI DRIVER AND EXE FILE WITH DOCUMENTATION FOR DOWNLOADING DATA FROM METER ALONG WITH SAMPLE METER IS SUBMITTED. (YES/NO)	BOOLEAN
76.0	CMRI APPLICATION IS SUBMITTED WITH ALL ITS DOCUMENTATION AND TRAINING ALONGWITH SAMPLE METER. (YES/NO)	BOOLEAN
77.0	TOTAL TIME TAKEN FOR DOWNLOADING ALL DATA FOR 45 DAYS IS 8 MINUTES (YES/NO)	BOOLEAN
78.0	DOWNLOADING TIME OF ONLY BILLING DATA IS LESS THAN 8 SECS (YES/NO)	BOOLEAN
79.0	BY DEFAULT, AFTER STARTING CMRI IS IN METER READING MODE. (YES/NO)	BOOLEAN
80.0	MEMORY OF CMRI IS 8 MB MIN. (YES/NO)	BOOLEAN

TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET ENERGY METER AS PER IS 15959/2011

81.0	CMRI POSSESSES SPECIFIC SERIAL NO. (YES/NO)	BOOLEAN
82.0	CMRI IS PROPERLY LABELED WITH SERIAL NUMBER / TENDER NUMBER / PROGRAM NAME / PROGRAM VERSION. (YES/NO)	BOOLEAN
83.0	BIDDER AGREES TO SUPPLY CMRI IN THE RATIO OF 1:1,000 INCLUDING USER MANUAL, AA SIZE BATTERIES & A SET OF DIRECT COMMUNICATION CORDS (YES/NO)	BOOLEAN
84.0	INTERFACE FOR COMMUNICATION BETWEEN CMRI & BASE COMPUTER SUPPLIED (YES/NO).	BOOLEAN
85.0	INDICATION FOR CONFIRMATION OF SUCCESSFUL DATA TRANSFER IS PROVIDED ON CMRI (YES/NO)	BOOLEAN
86.0	CMRI DOES NOT ACCEPT ANY EXTERNAL FILE OTHER THAN BCS. (YES/NO).	BOOLEAN
87.0	BEFORE DELETING DATA FROM CMRI, PROVISION TO ASK PROMPT (YES/NO) TWICE TO USER FOR CONFIRMATION TO DELETE DATA IS PROVIDED ON CMRI. (YES/NO)	BOOLEAN
88.0	USB PORT ARE PROVIDED ON CMRI (YES/NO)	BOOLEAN
89.0	NECESSARY SOFTWARE CONFORMING REQUIRED FOR CMRI & BASE COMPUTER SYSTEM WITH NECESSARY SECURITY PROVISIONS IS SUPPLIED. (YES/NO)	BOOLEAN
90.0	CMRI CAPABLE OF DOWNLOADING BILLING DATA OF AT LEAST 2,000 (TWO THOUSAND) METERS AT A TIME (YES/NO)	BOOLEAN
91.0	CMRI HAS FACILITY FOR RE-ENTERING METER SERIAL NUMBERS DIRECTLY FROM BASE COMPUTER SYSTEM (YES/NO)	BOOLEAN
92.0	METER IS TYPE TESTED (YES/NO)	BOOLEAN
93.0	TYPE TEST REPORT NUMBER & DATE	TEXT
94.0	GUARANTEE 5 YEARS FROM INSTALLATION OR FIVE & HALF YEARS FROM DATE OF DESPATCH (YES/NO)	BOOLEAN
95.0	FOLLOWING IN HOUSE TESTING FACILITIES ARE AVAILABLE (A) INSULATION RESISTANCE MEASUREMENT (YES/NO)	BOOLEAN

**TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET
ENERGY METER AS PER IS 15959/2011**

96.0	(B) NO LOAD CONDITION (YES/NO)	BOOLEAN
97.0	(C) STARTING CURRENT TEST (YES/NO)	BOOLEAN
98.0	(D) ACCURACY TEST REQUIREMENT (YES/NO)	BOOLEAN
99.0	(E) POWER CONSUMPTION (YES/NO)	BOOLEAN
100.0	(F) TRANSPORTATION TEST AS PER SPECIFICATION (YES/NO)	BOOLEAN
101.0	(G) FULLY COMPUTERISED METER TEST BENCH SYSTEM FOR CARRYING OUT ROUTINE AND ACCEPTANCE TEST IS AVAILABLE (YES/NO)	BOOLEAN
102.0	(H) THE MANUFACTURER SHALL HAVE DULY CALIBRATED STANDARD METER OF 0.1 CLASS ACCURACY (YES/NO)	BOOLEAN
103.0	(I) GLOW WIRE TESTING (YES/NO)	BOOLEAN
104.0	FURNISH PRINCIPLE OF OPERATION OF METER OUTLINING METHODS & STAGES OF COMPUTATIONS OF VARIOUS PARAMETERS STARTING FROM INPUT VOLTAGE & CURRENT SIGNALS INCLUDING SAMPLING RATE IF APPLICABLE	TEXT
105.0	MANUFACTURING ACTIVITIES ARE AVAILABLE AS PER CLAUSE 26.00 (YES/NO)	BOOLEAN
106.0	QAP SUBMITTED AS PER ANNEXURE-I (YES/NO)	BOOLEAN
107.0	AGEING TEST IS CARRIED OUT ON METER (YES/NO)	BOOLEAN
108.0	PERMANENT NATURE CONNECTION DIAGRAM OF METER IS SHOWN ON INSIDE PORTION OF THE TERMINAL COVER. (YES/NO)	BOOLEAN
109.0	METER TERMINALS ARE MARKED AND THIS MARKING APPEARS IN THE ABOVE PERMANENT NATURE CONNECTION DIAGRAM. (YES/NO)	BOOLEAN
110.0	NAME PLATE & MARKING AS PER TECHNICAL SPECIFICATION (YES/NO)	BOOLEAN
111.0	QUALIFYING REQUIREMENT (A) TURN OVER OF 30 CRORES DURING ANY ONE OF LAST 3 FINANCIAL YRS (YES/NO)	BOOLEAN

TECHNICAL SPECIFICATION OF LT AC SINGLE PHASE 5-30 AMPS STATIC NET ENERGY METER AS PER IS 15959/2011

112.0	(B) MIN. 5 LAKHS STATIC METERS SUPPLIED DURING LAST 3 FINANCIAL YRS. OUT OF WHICH 2 LAKH METERS SUPPLIED IN IMMEDIATE PRECEEDING FINANCIAL YEAR (YES/NO).	BOOLEAN
113.0	(C) MIN. 3 YEARS EXPERINECE OF SUPPLY OR MANUFACTURING STATIC METERS UPTO THE END OF LAST FINANCIAL YEAR. (YES/NO).	BOOLEAN
114.0	WHETHER YOU AGREE TO SUPPLY METERS AS PER ANEXURE-D, I.E. TECHNICAL SPECIFICATIONS OF THE TENDER. (YES/NO)	BOOLEAN
115.0	WHETHER TYPE TEST REPORTS ALONGWITH COPY OF SAME IN TWO CDS ARE SUBMITTED (YES/NO)	BOOLEAN
116.0	WHETHER 15 NOS. OF TENDER SAMPLE METERS AND ONE NO. OF CMRI, RELEVANT SOFTWARE & DOCUMENTATION, ETC. ARE SUBMITTED ALONGWITH OFFER. (YES/NO)	BOOLEAN